


Shower and Eyewash CHECKLIST & RECOMMENDED GUIDELINES

This checklist is a summary of the provisions of ANSI Z358.1-2014 relating to eye or eye wash and shower combination stations. Please refer to the Standard for a complete listing of these provisions.

- | | |
|--|---|
| <p>Y N</p> <p><input type="radio"/> <input type="radio"/></p> | <p>Can both the shower and eye wash components deliver an adequate flow of water when working simultaneously? (Section 4.5.5, 7.4.4)</p> <p>Does the "hands free" stay-open valve activate in one second or less? (Section 4.2)</p> <p>Is the height of water column between 82" (208.3 cm) and 96" (243.8 cm) above the floor? (Section 4.1.3, 4.5.4)</p> <p>Does the shower provide 20 gallons (75.7 liters) of water per minute for 15 minutes? (Section 4.1.2, 4.5.5)</p> <p>Is the actuator easily located, accessible and no higher than 69" (173.3 cm) above the floor? (Section 4.2)</p> <p>At 60" (152.4 cm) above floor, is the water pattern at least 20" (50.8 cm) in diameter? (Section 4.1.4)</p> <p>Is the center of water pattern at least 16" from any obstructions? (Section 4.1.4, 4.5.4)</p> <p>Is the flushing fluid flow pattern positioned between 33" (83.8 cm) and 53" (134.6 cm) from the floor and at least 6" (15.3 cm) from the wall or nearest obstruction? (Section 5.4.4, 6.4.4)</p> <p>Are the outlet heads protected from airborne contaminants? Covers will easily be removed by the water flow. (Section 5.1.3, 6.1.3)</p> <p>Is the valve actuator easy to locate and readily accessible to user? (Section 5.2, 6.2)</p> <p>Does the secondary "hands free" stay-open valve activate in one second or less? (Section 5.2, 6.1.4, 6.2)</p> <p>Does the unit deliver at least 3.0 GPM (11.4 liters) (for eye/ face wash) or 0.4 GPM (1.5 liters) (for eyewash) for 15 minutes? (Section 5.1.6, 6.1.6, 6.4.5)</p> |
|--|---|

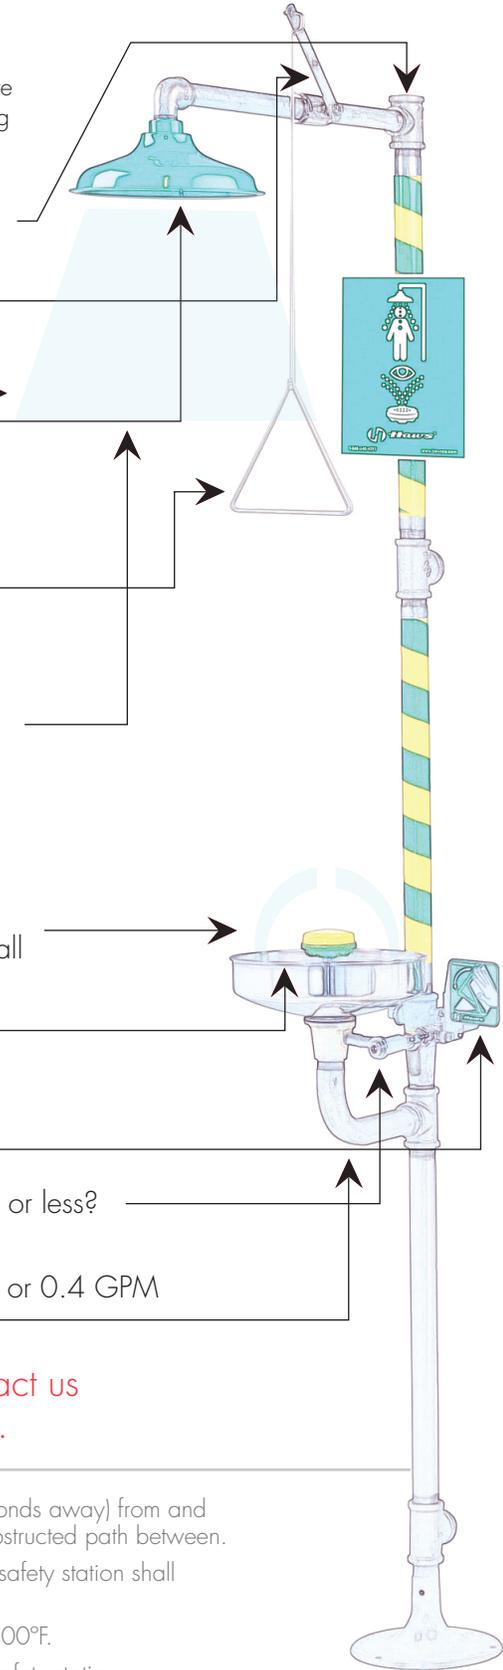

If you answered **NO** to any of these questions - contact us today to book your no-charge Third Party review.

ADDED CONSIDERATIONS

- | | |
|---|---|
| <p>Location (Section 7.4.2; B5)</p> <p>Identification (Section 7.4.3)</p> <p>Water temperature (Section 7.4.5)</p> <p>Training (Section 7.5.4)</p> <p>Maintenance/inspection (Section 7.5.2) (Section 7.5.5)</p> | <p>Install the safety solution within 55 feet (approximately 10 seconds away) from and on the same level as the hazard. Be sure there is a clear, unobstructed path between.</p> <p>Identify safety station with highly-visible sign. Area around the safety station shall be well lit.</p> <p>Water delivered by safety station shall be tepid between 60-100°F.</p> <p>Instruct all employees in the location on the proper use of the safety station.</p> <p>Activate safety station at least weekly. Inspect annually for compliance with Standard.</p> |
|---|---|